




**NO HEADWALL**

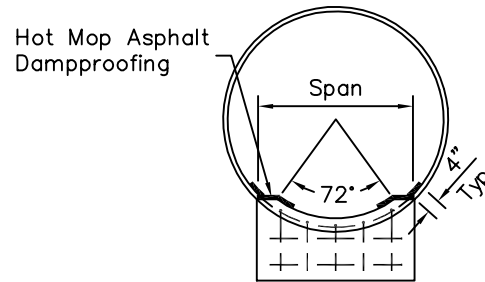

**ELEVATION B-B**

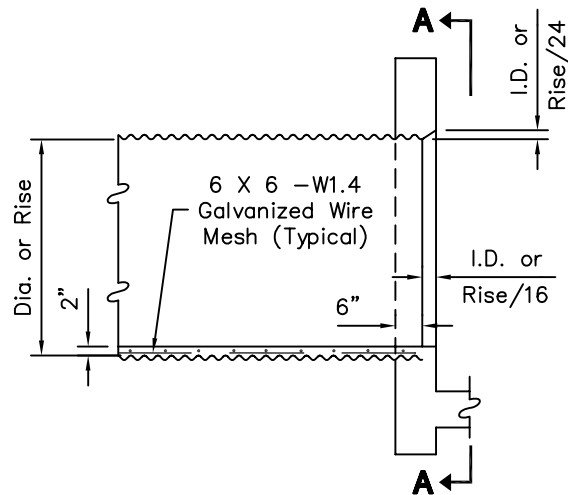

**WITH HEADWALL**

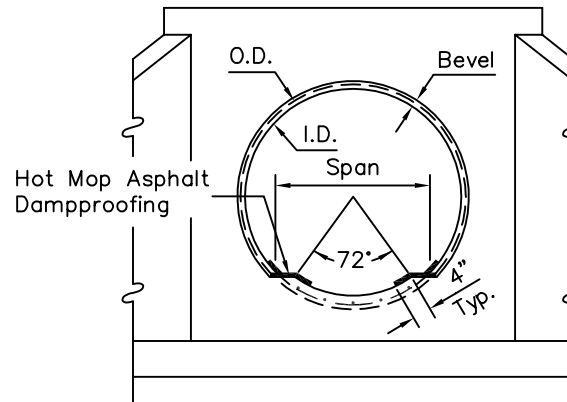

**ELEVATION A-A**

**GENERAL NOTES**

1. For lateral dimensions of invert paving, use 72° control for CMP and span for CMPA.
2. Paving shall be scored at 18" min. (transverse) along pipe length.
3. Use bevel on inlet headwall only.
4. Wire mesh shall be tack welded to corrugation crests at 18" intervals. Laps shall be 6" min.
5. Paving shall not be placed until backfilling is completed.
6. Concrete shall be Class "B".

DETAIL NO.  
**2554**

**City of Scottsdale**  
**Standard Details**

APPROVED BY:

**CONCRETE INVERT PAVING FOR**  
**CORRUGATED METAL PIPE AND PIPE ARCH**

DETAIL NO.  
**2554**